


PLAN SECTION

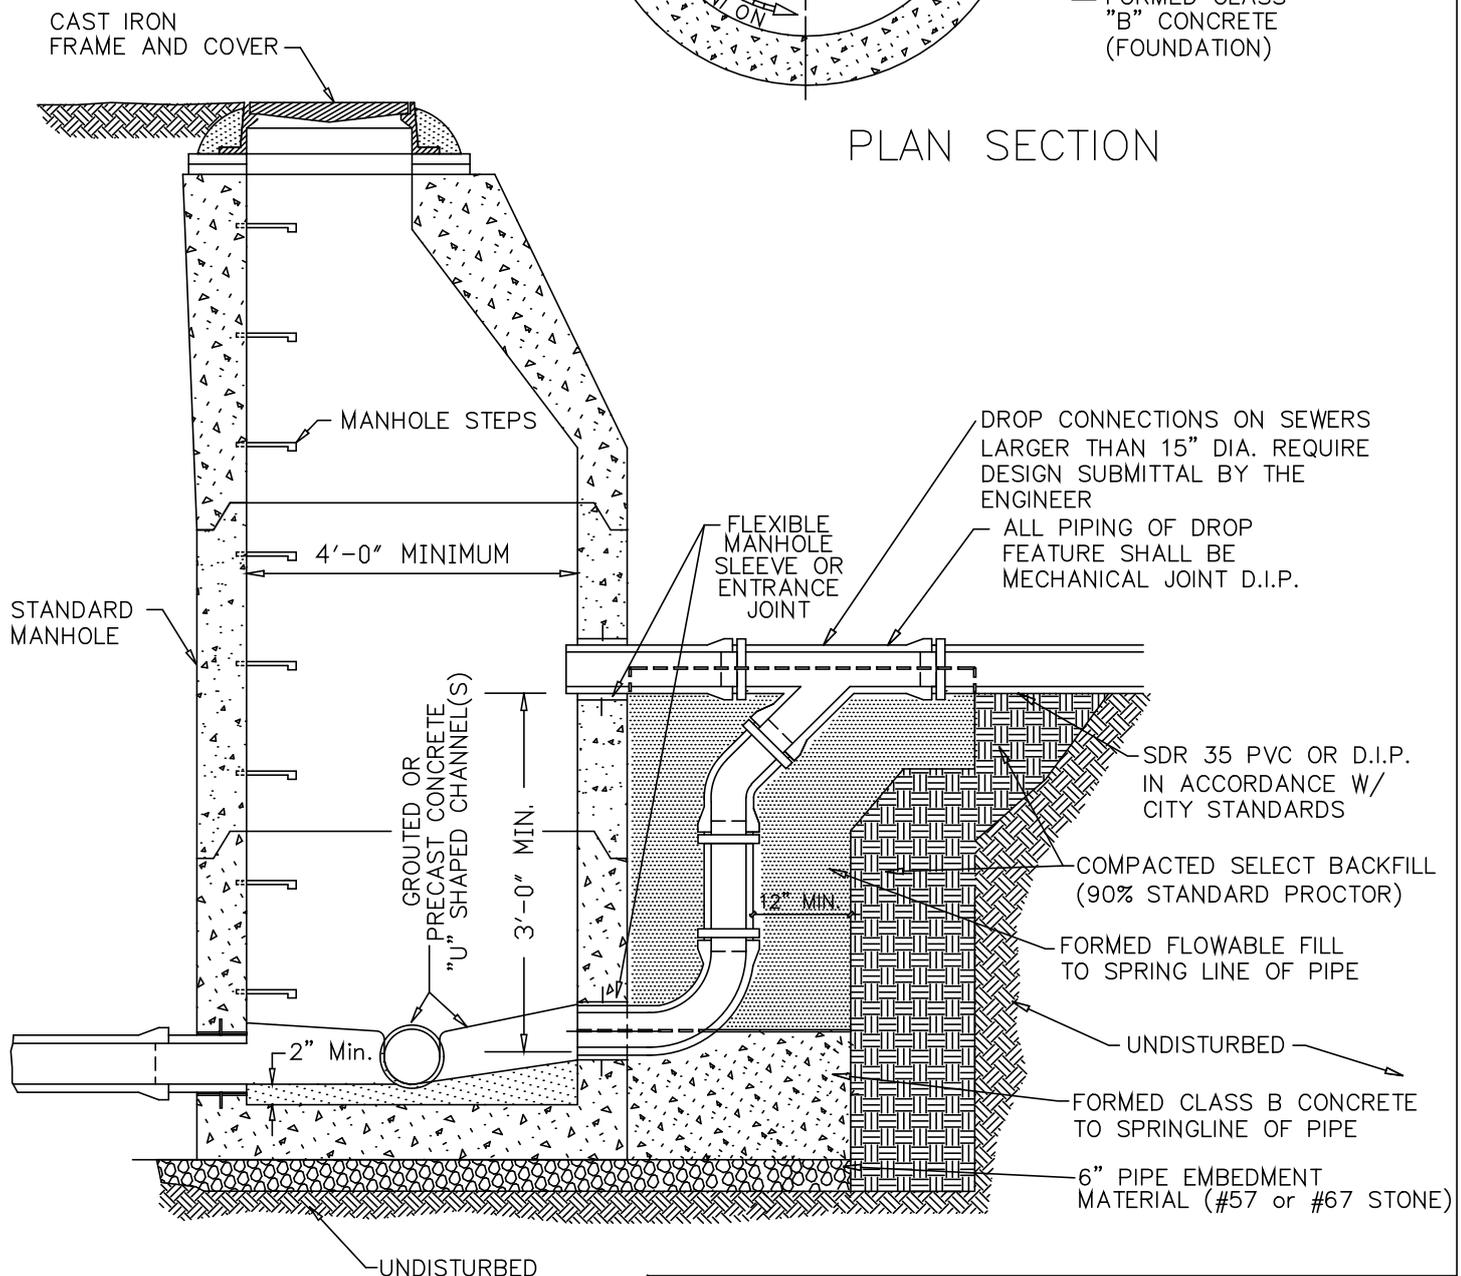

SECTION A-A

NOTE: MANHOLE STEPS TO BE VERTICALLY IN LINE WITH "INVERT OUT" FOR PIPE 18" AND LESS. OVER 18" TO BE LOCATED IN LINE WITH BENCH. TYPE III OR IV DROP IS REQUIRED FOR ALL DROPS WHERE THE GRADE OF THE INFLUENT LINE IS GREATER THAN 5.0%

STANDARD DETAIL  
CITY OF CAYCE

TYPE III DROP CONNECTION

APPROVED: # CAYCE-4C