


NOTES:

1. WYE CONNECTIONS ARE STANDARD FOR NEW SEWER MAIN CONSTRUCTION.
2. FORCE MAINS CARRYING DOMESTIC WASTEWATER FROM SANITARY CONVENIENCES WITHIN A SINGLE BUILDING, MAY BE CONNECTED TO A 4" CITY GRAVITY SERVICE LINE PROVIDED THAT GRAVITY FLOW WILL BE MAINTAINED DURING PROPOSED MAXIMUM DISCHARGE RATE FOR THE GRINDER OR EFFLUENT PUMP(S).
3. WHERE COVER IS LESS THAN 3 FT. DUCTILE IRON MUST BE USED. ALL DUCTILE IRON SEWER PIPE AND FITTINGS SHALL BE INTERNALLY COATED WITH PROTECTO 401.
4. WHERE DUCTILE IRON IS REQUIRED RISER MAY BE CONSTRUCTED WITH SDR-35 PVC.
5. TRACER WIRE REQUIRED OVER SERVICE LINE.

2' MAX. UNLESS OTHERWISE INDICATED

BRASS OR BRONZE PLUG

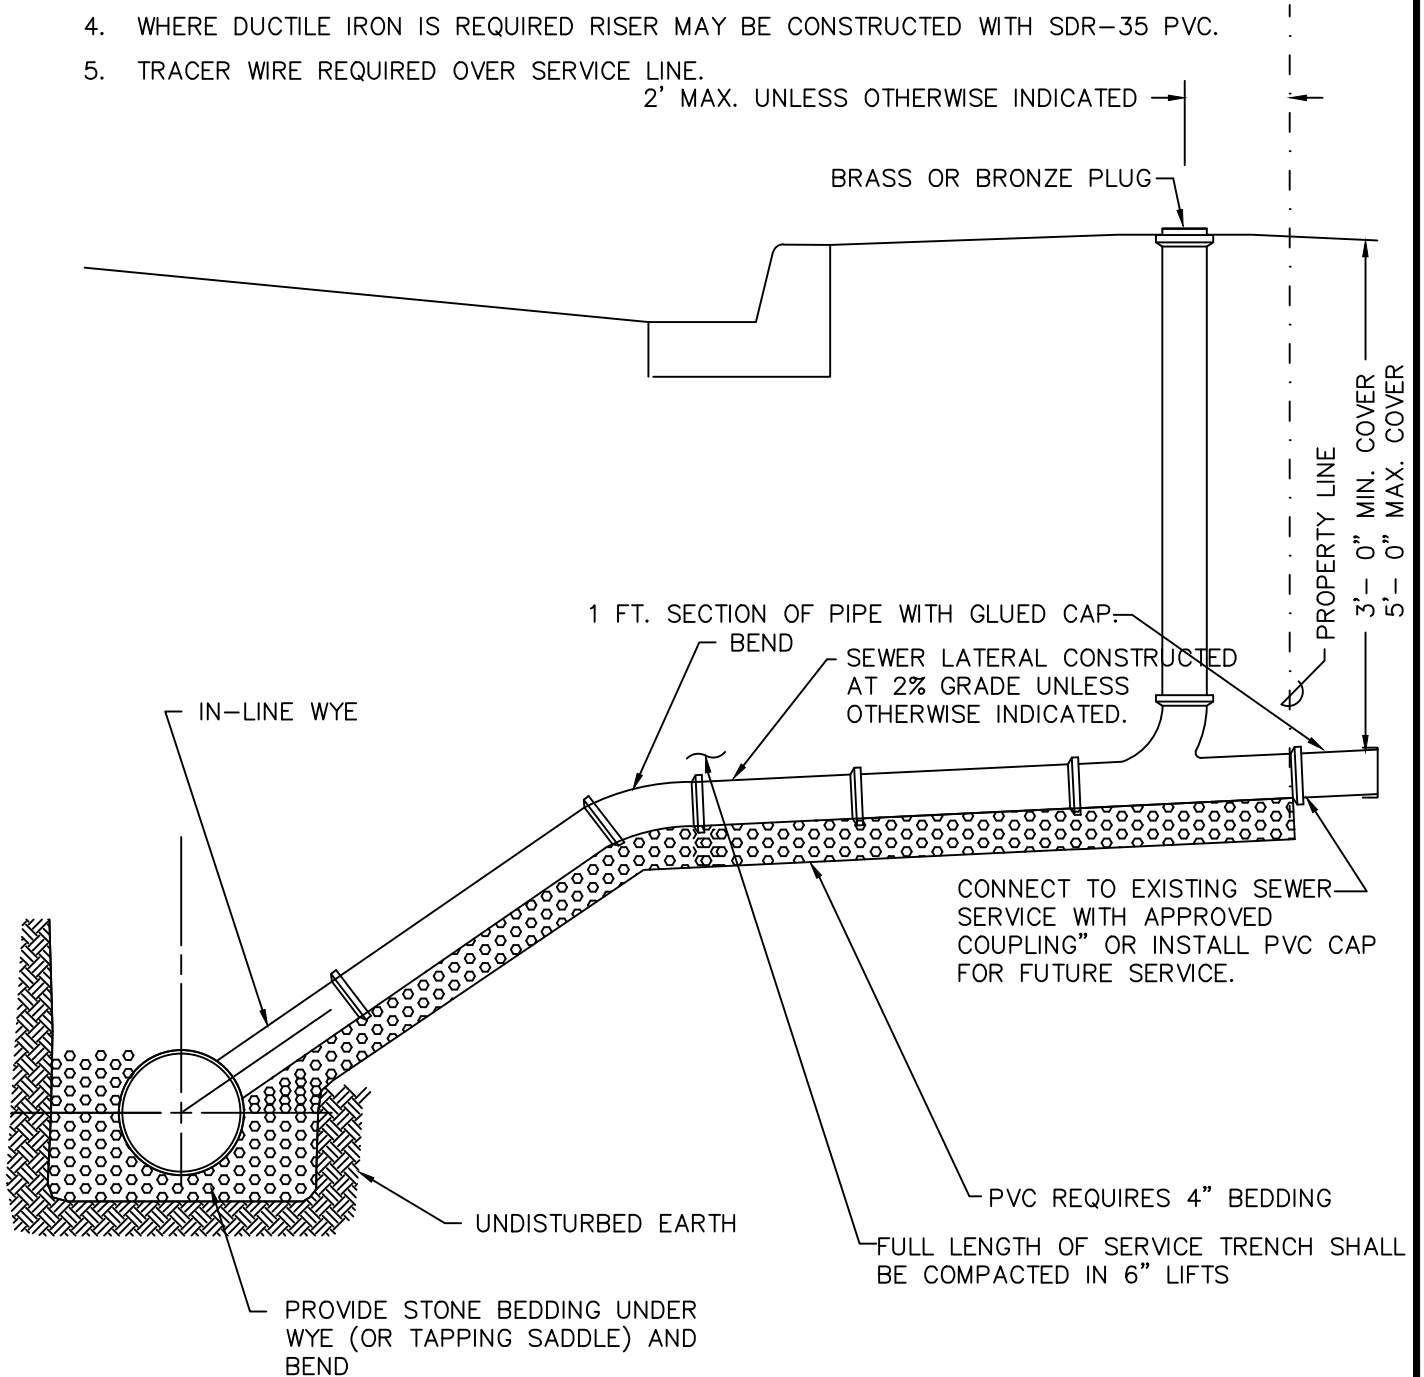

STANDARD DETAIL	
CITY OF CAYCE	
SANITARY SEWER SERVICE	
APPROVED:	# CAYCE-11A